



NO
DUMPING

PLEASE DO NOT
DUMP OIL, GREASE,
FLUIDS, OR OTHER
HARMFUL SUBSTANCES
HERE.

Milton's Pond
Sanitary Lift Station
Box 10 8023
2175 Chalkwater Dr.



Miller's Pond
Sanitary Lift Station
Site ID: S121
2773 Cheakamus Way
In case of water or sewer emergency
call BCCWA 24-hour hotline 804-833-8328



DANGER
KEEP OFF
KEEP OFF









DANGER
LOCK OUT
EQUIPMENT
BEFORE SERVICING

R.M.O.W.
Procedures
For
W.C.B.
Regulations

Liebert
LM

Hece

DDC

MAIN DISCONNECT



PROTECTION
CB1 CB2 CB3 CB4 CB5




PUMP #1



PUMP #2



DANGER
**LOCK OUT
EQUIPMENT
BEFORE SERVICING**

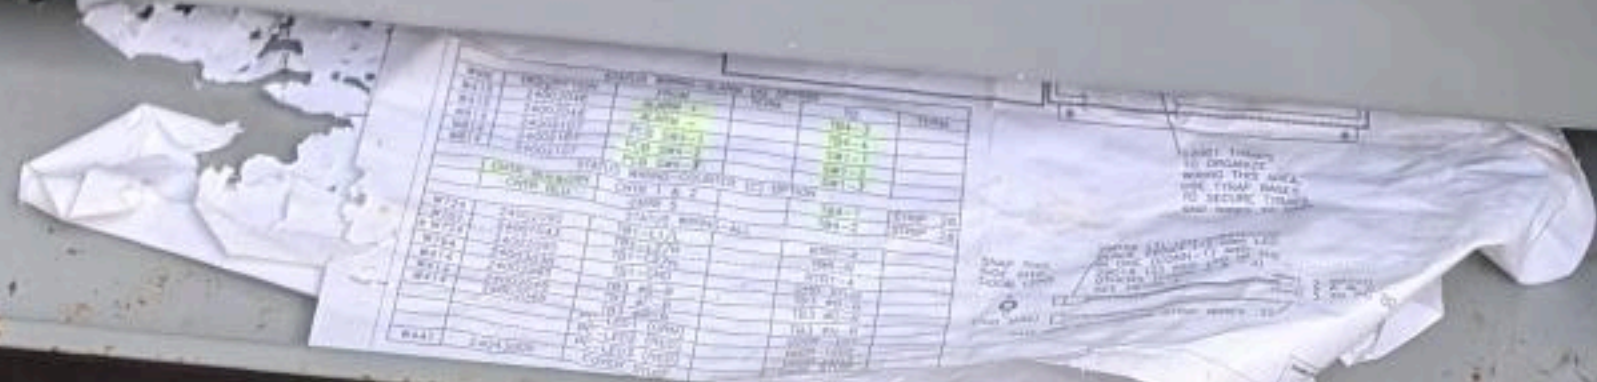

DANGER
Power B
EMERSON
Network Power

Power832

Date | Time
OCT 16/24 | 1:58P

Ready Armed Trouble

Stay
Away
Chime
Reset
Exit

1 2 3
4 5 6
7 8 9
* 0 #

PROTECTED
BY
**SEA TO SKY
SECURITY**
905-2500

MARCH 2024

**SEA TO SKY
SECURITY**
FALSE ALARM • 604-905-3912
SERVICE • 604-905-2500

a

10





600V AC or less
10KA IR
Ferraz Shawmut
Mexico
Celco
29/16



Bus Bar
Ferraz Shawmut

Circuit Breaker
Disjoncteur Embranché



LISTED TO UL IN
OUTLET BOX VOLUME
700 A

FOR HAZARDOUS LOCATIONS
CLASS I, GROUP D - CLASS II, GROUPS F & G

CAUTION: TO PREVENT IGNITION OF HAZARDOUS
ATMOSPHERES, DISCONNECT FROM THE SUPPLY
CIRCUIT BEFORE OPENING ENCLOSURE. KEEP TIGHTLY
CLOSED WHEN CLOSED AND LOCKED.

ATTENTION: AFIN DE PRÉVENIR L'INFLAMMATION D'ATMOSPHÈRES
DANGEREUSES, DÉBRANCHER LE CÂBLAGE AVANT D'OUVRIR LE COUVERCLE
GARDER LE COUVERCLE BIEN FERMÉ LORSQUE LES CIRCUITS SONT
SOUS TENSION.

BALDOR
PT. NO. 35CB3500

1000
100
10
1
0.1
0.01
0.001

1000
100
10
1
0.1
0.01
0.001





LISTED
OUTLET BOX
790 A

16 CU. IN.
VOLUME

W

FOR HAZARDOUS LOCATIONS
CLASS I, GROUP D - CLASS II, GROUPS F & G

CAUTION: TO PREVENT IGNITION OF HAZARDOUS
ATMOSPHERES, DISCONNECT FROM THE SUPPLY
CIRCUIT BEFORE OPENING ENCLOSURE. KEEP TIGHTLY
CLOSED WHILE CIRCUITS ARE ALIVE.

ATTENTION: AFIN DE PRÉVENIR L'INFLAMMATION D'ATMOSPHÈRES
DANGEREUSES, OUVRIR LE CIRCUIT AVANT D'ENLEVER LE COUVERCLE
GARDER LE COUVERCLE BIEN FERMÉ LORSQUE LES CIRCUITS SONT
SOUS TENSION.

NP0018

BALDOR

PT. NO. 35CB3500

